



TOWER FOUNDATION

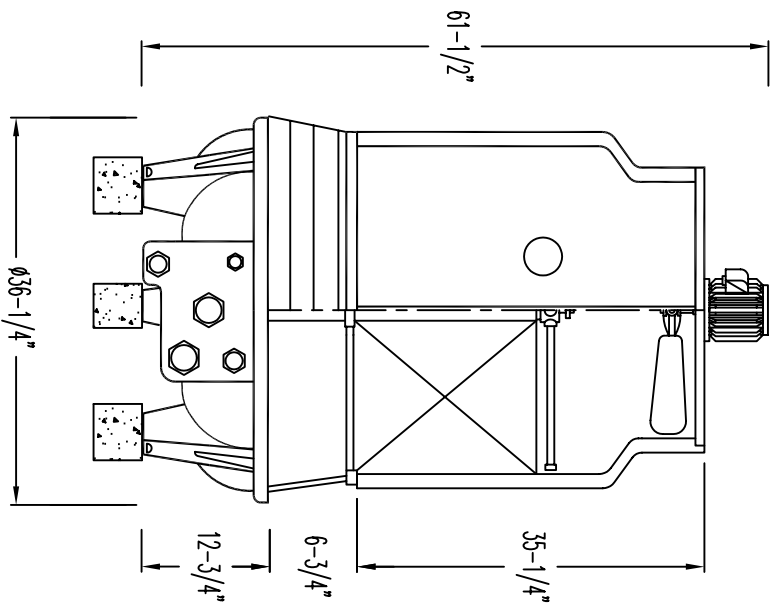

TOWER OVERALL DIMENSION

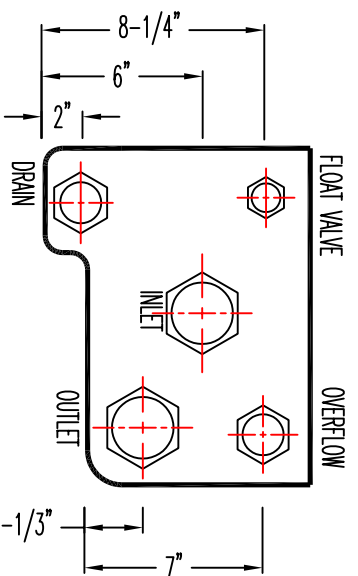

LOADING POINT(lbs)	TOWER WEIGHT(lbs)	
	NET WEIGHT	OPERATING WEIGHT
STAND	123	311
TANK	104	—
OUTLET	1-1/2"	—
INLET	1-1/2"	—
OVERFLOW	1"	—
DRAIN	1"	—
AUTOMATIC MAKE-UP	1/2"	—
MANUAL MAKE-UP	—	—

PIPING

- NOTES:
1. THE COOLING TOWER MUST BE LOCATED AT SUCH DISTANCE AND DIRECTION TO AVOID THE POSSIBILITY OF CONTAMINATED TOWER DISCHARGE AIR BEING DRAWN INTO BUILDING FRESH AIR INTAKES
 2. ANCHOR BOLT BY OTHERS.
 3. CONTINUING ENGINEERING RESEARCH RESULTS IN STEADY IMPROVEMENTS. THEREFORE, THESE SPECIFICATIONS AND DATA ARE SUBJECT TO CHANGE WITHOUT NOTICE. CONSULT WITH FACTORY FOR CURRENT CERTIFIED DIMENSIONS.

APPROVED	KM LIN	06.27.2007	DWG TITLE:	TOWER DIMENSIONS AND FOUNDATION
CHECKED	NOJIN	11.06.2007	DWG DETAIL:	PCT-8
DRAWN	HUANG	06.27.2007	DWG NO.:	AFP-0008-0
ITEM	ZENG	06.26.2007	BY	DO NOT SCALE
			DATE	PROTEC COOLING TOWERS, INC.